


THIS DRAWING, ITS SPECIFICATIONS AND DESIGNS, IS THE PROPERTY OF UV PURE TECHNOLOGIES INC. AND IS SUBJECT TO RETURN UPON REQUEST. IT IS SUBMITTED ON THE CONDITION THAT IT WILL NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT UV PURE'S WRITTEN APPROVAL.

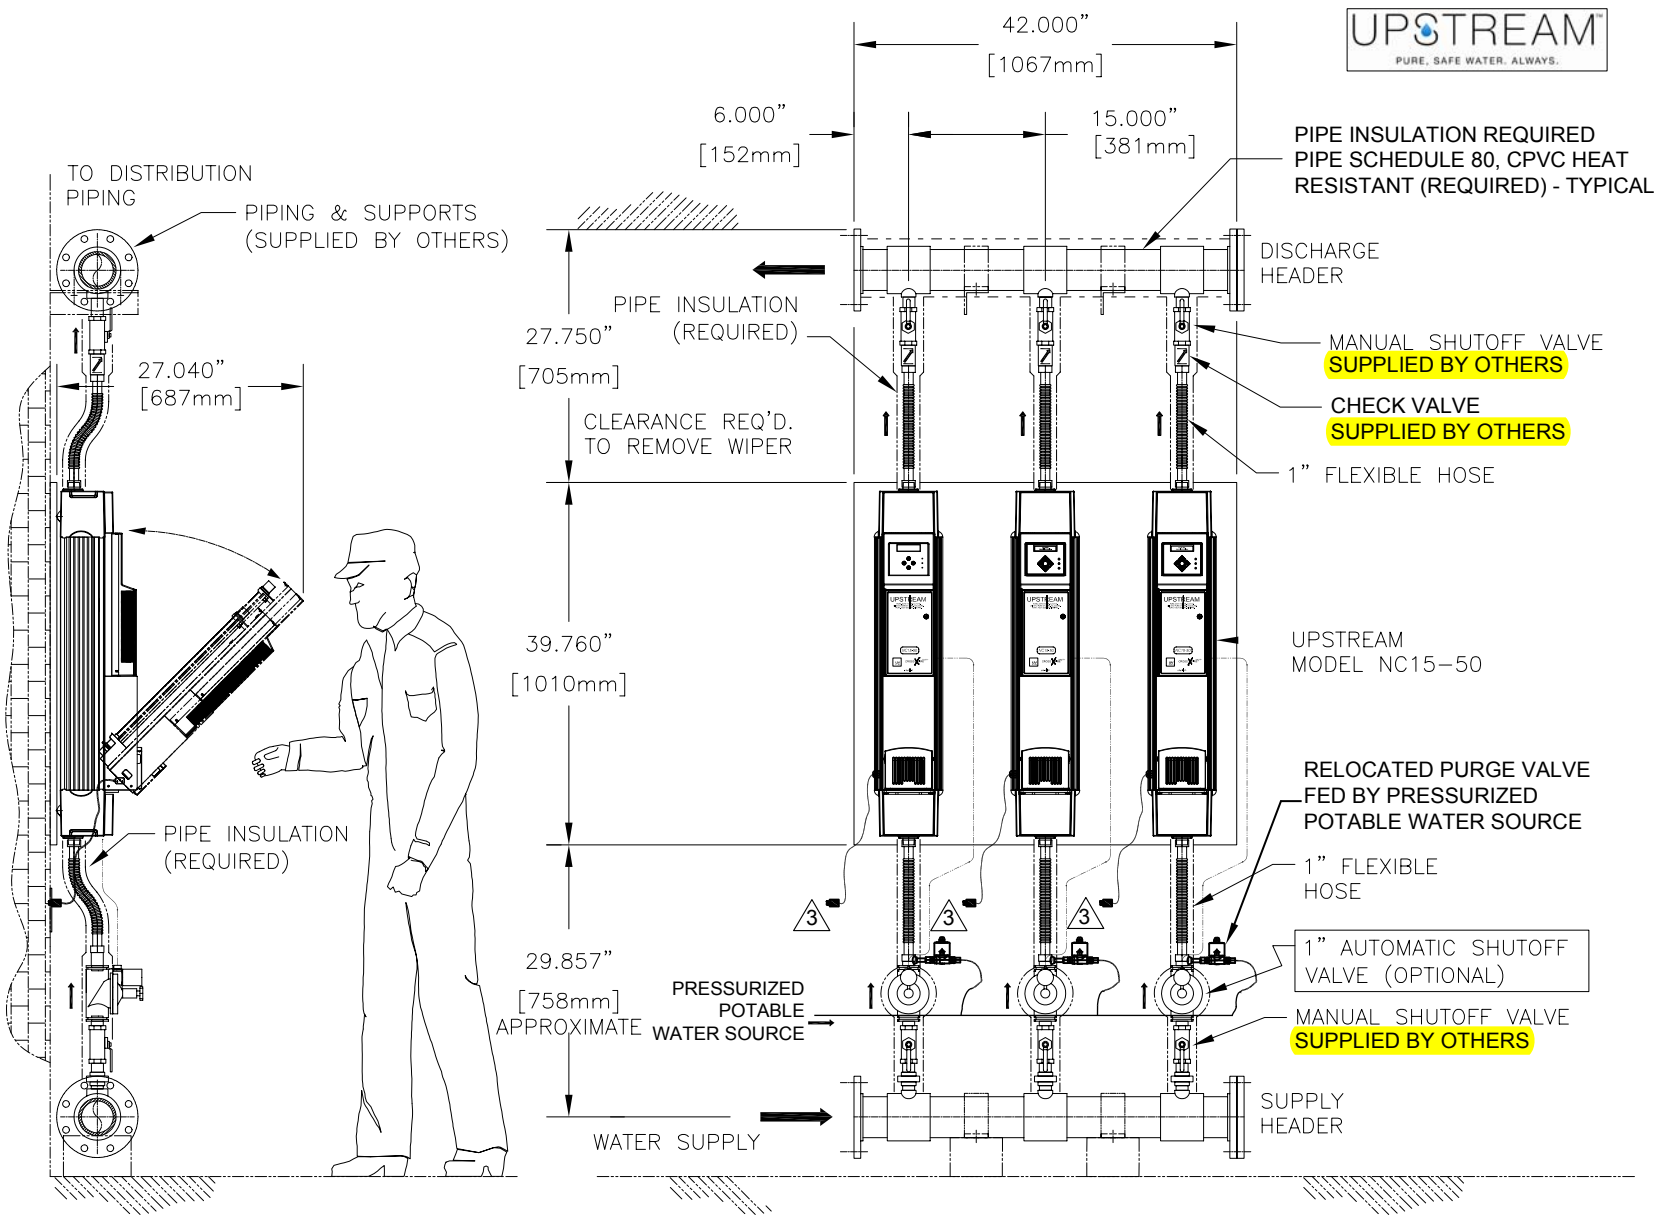

SIDE VIEW

ELEVATION VIEW

REVISIONS			
REV	DESCRIPTION	DATE	APP'D
A			
B			
C			
D			
E			

- NOTES**
- 1-ALL UV EQUIPMENT, AUTOMATIC SHUTOFF VALVES (WHEN SPECIFIED) AND FLEXIBLE HOSES SHALL BE PROVIDED LOOSE BY UV PURE.
  - 2-PIPING, PIPE FITTINGS AND INSULATION; MANUAL SHUTOFF AND CHECK VALVES SHALL BE PROVIDED BY OTHERS.
  - 3- UNITS TO BE PLUGGED INTO UPS (SUPPLIED BY eda) PROTECTED BY 20 AMP BREAKER (SUPPLIED BY OTHERS)
  - 4- MINIMUM OF 4' OF DISCHARGE PIPING TO BE HEAT RESISTANT TYPE AS NOTED

**FINISH**

--

**MATERIAL**

--

**DIMENSIONS IN INCHES (unless otherwise specified)**  
**TOLERANCES (unless otherwise specified)**  
 ANGULAR ±0°30' DECIMAL 2 PLACES ±.010  
 FRACTIONAL ±1/32 DECIMAL 3 PLACES ±.005  
 DECIMAL 1 PLACE ±.015 DECIMAL 4 PLACES ±.0005

UV PURE TECHNOLOGIES INC.  
 60 VENTURE DR., UNIT 19  
 TORONTO, ONTARIO  
 M1B 3S4

	NAME	SIGN.	DATE
DRAWN	D.P.		30 APR 07
DESIGN			
CHECK			
APPR.			

<b>TITLE</b>		
ELEVATION LAYOUT 3x NC15-50		
SHEET No.	SHEET 1 OF 1	SCALE NONE
DWG. No.	000-R-900023	REV. -